

## INSTRUCTION MANUAL

### Contents

GENERAL SAFETY INFORMATION .....	1
1.0 INSTALLATION .....	2
2.0 OPERATION .....	3
3.0 MAINTENANCE .....	4
TROUBLESHOOTING GUIDE .....	6
SPECIFICATIONS .....	7-8
ELECTRICAL SCHEMATICS .....	9
DIMENSIONS AND WEIGHTS .....	10-12
PARTS LIST .....	13-14
WARRANTY .....	16

### GENERAL SAFETY INFORMATION

#### ⚠ CAUTION

#### 1. Pressurized devices

This equipment is a pressure containing device.

- Do not exceed maximum operating pressure as shown on equipment serial number tag.
- Make certain equipment is depressurized before servicing.

#### 2. Electrical

This equipment requires electricity to operate.

- Install equipment in compliance with national and local electrical codes.
- Standard equipment is supplied with NEMA 1 electrical enclosures and is not intended for installation in hazardous environments.
- Disconnect power supply to equipment when performing any electrical service work.

#### 3. Breathing air

- Air treated by this equipment may not be suitable for breathing without further purification. Refer to OSHA standard 1910.134 for the requirements for breathing quality air.



**HIT SERIES**

**HIGH INLET**

**TEMPERATURE**

**REFRIGERATED**


**COMPRESSED**

**AIR DRYERS**

## 1.0 INSTALLATION

### 1.1 Location

- A. Air compressor intake - Locate air compressor so that contaminants potentially harmful to the dryer are not drawn into the air system.
- B. Free air flow - Do not block either side of the cabinet. Observe minimum installation clearances as shown.

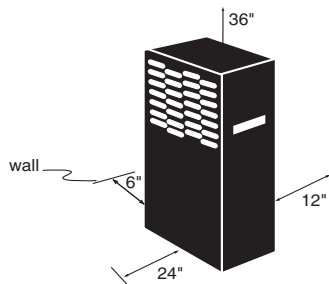

### 1.2 Mounting

Dryer is suitable for floor or shelf mounting.

### 1.3 Piping connections



- A. Air Inlet - Connect compressed air line from air compressor to air inlet using strainer supplied.

1. Install strainer (included in shipping carton) prior to dryer inlet using pipe nipple supplied or other piping as required.

NOTE: Observe flow direction arrows on strainer.

NOTE: Install strainer where it is easily accessible for cleaning.

NOTE: Use vibration dampener, if vibration exists in air line at inlet to dryer.

2. Location in the compressed air system

- A. **WARNING** Maximum working pressure - 250 psig, 17.6 kgf/cm<sup>2</sup>. Do not exceed unit's Maximum Working Pressure.

- 1) For maximum capacity, install unit in air system at highest pressure possible (e.g. before pressure reducing valves)
- 2) For maximum capacity, install unit at coolest compressed air temperature possible. Maximum inlet compressed air temperature: 180°F, 82°C. If inlet air exceeds this temperature, precool the air by extending the piping between the compressor and the dryer.

- B. Air Outlet - Connect air outlet to downstream air lines.

- C. By-pass piping - If servicing the unit without interrupting the air supply is desired, piping should include inlet and outlet isolation valves and an air by-pass valve.

- D. Condensate drain - It is advisable to connect drain outlet to the condensate drainage system.

NOTE: Drain discharge is at system pressure. Drain line should be anchored to prevent whipping.

### 1.4 Electrical connections


- A. Dryer is designed to operate on power supply (voltage) listed on serial number tag located on the back of the dryer.
- B. Dryer is supplied with an electrical cord. Install in receptacle of proper voltage.

NOTE: Models 50 and 75 (115v only) - Install plug in receptacle rated for 20 amps. Units are supplied with 20 amp plug.



Plug

NOTE: Refrigeration system is designed to run continuously and should NOT be wired to cycle on/off with the air compressor.

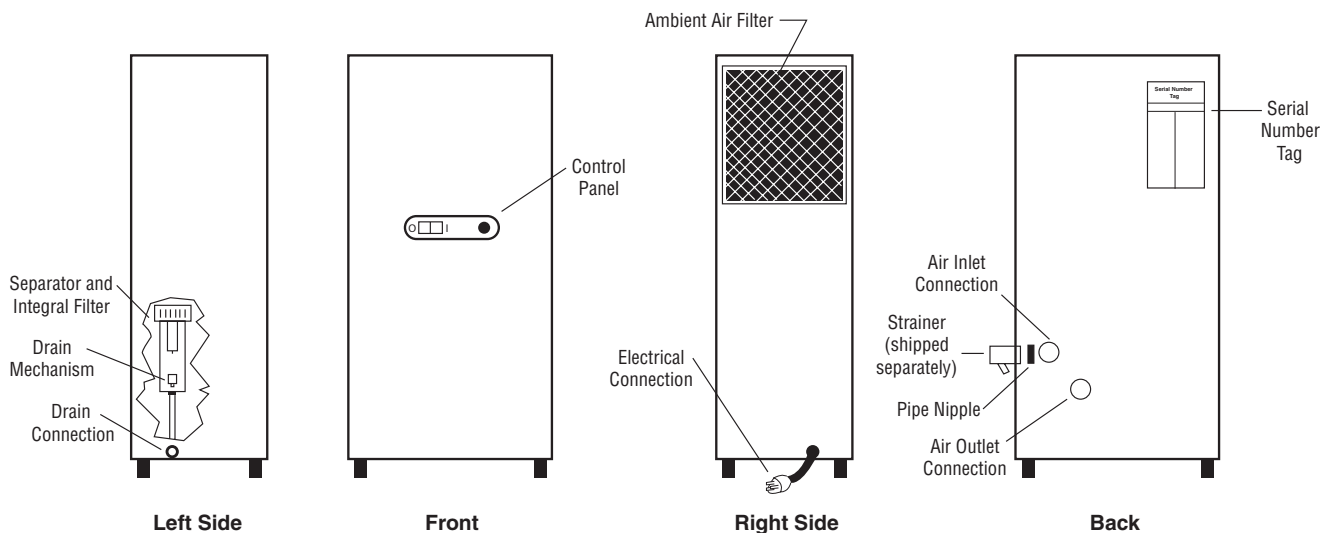


## 2.0 OPERATION

NOTE: Installations above 6000 feet, 1825 meters  
Unit is adjusted to operate in altitudes up to 6000 feet, 1825 meters. If unit is installed in an altitude above this, and has not been preset at the factory for this altitude, contact Manufacturer's Service Department.

### 2.1 Start-up

Start refrigeration system by pushing the on/off switch to the ON position (depress rocker switch on side marked "I").

NOTE: The fault light may illuminate when unit is energized. Light should go out approximately 5 minutes after start-up. If light remains lit after 30 minutes or illuminates after going out, refer to Troubleshooting Guide.

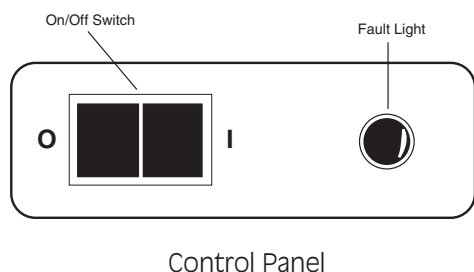

### 2.2 Operating check points

Check the following on a periodic basis:

- Rocker switch is in the ON position.
- Amber fault light is out.
- Condensate is being regularly discharged.

### 2.3 Minimum/maximum operating conditions

- Minimum/Maximum air pressure: 20/250 psig, 1.4/17.6 kgf/cm<sup>2</sup>
- Maximum inlet air temperature: 180°F, 82°C
- Minimum/Maximum ambient temperature: 35/110°F, 2/43°C

#### D. Maximum flow capacity

- For dryers without an aftercooler installed upstream  
Flow capacity in scfm (m<sup>3</sup>/min) @ 180°F, 82°C inlet temperature, 160°F, 71°C inlet pressure dew point, 95°F, 35°C ambient temperature, 50°F, 10°C outlet pressure dew point, and less than 5 psi, 0.35 kgf/cm<sup>2</sup> pressure drop.

#### 60 HZ

Inlet Pressure psig (kgf/cm <sup>2</sup> )		175 (12.3)	150 (10.6)	125 (8.8)	100 (7.0)
Model	20	23 (0.65)	22 (0.62)	20 (0.57)	18 (0.51)
	25	29 (0.82)	27 (0.76)	25 (0.71)	23 (0.65)
	35	41 (1.16)	38 (1.08)	35 (0.99)	32 (0.91)
	50	58 (1.64)	54 (1.53)	50 (1.42)	45 (1.27)
	75	87 (2.46)	81 (2.29)	75 (2.12)	68 (1.93)
	100	116 (3.29)	108 (3.06)	100 (2.83)	91 (2.58)
	125	145 (4.12)	135 (3.82)	125 (3.54)	114 (3.23)

#### 50 HZ

Inlet Pressure psig (kgf/cm <sup>2</sup> )		175 (12.3)	150 (10.6)	125 (8.8)	100 (7.0)
Model	20	20 (0.57)	18 (0.51)	17 (0.48)	15 (0.42)
	25	24 (0.68)	23 (0.65)	21 (0.59)	19 (0.54)
	35	31 (0.88)	29 (0.82)	27 (0.76)	24 (0.68)
	50	58 (1.64)	54 (1.53)	50 (1.42)	45 (1.27)
	75	71 (2.01)	66 (1.87)	61 (1.73)	55 (1.56)
	100	97 (2.75)	90 (2.55)	83 (2.35)	76 (2.15)
	125	121 (3.43)	112 (3.17)	104 (2.95)	95 (2.69)

- For dryers with an aftercooler installed upstream  
Flow capacity in scfm (m<sup>3</sup>/min) @ 100°F, 38°C inlet temperature, 100°F, 38°C inlet pressure dew point, 100°F, 38°C ambient temperature, 50°F, 10°C outlet pressure dew point, and less than 10 psi, 0.7 kgf/cm<sup>2</sup> pressure drop.

#### 60 HZ

Inlet Pressure psig (kgf/cm <sup>2</sup> )		175 (12.3)	150 (10.6)	125 (8.8)	100 (7.0)
Model	20	32 (0.91)	30 (0.85)	28 (0.79)	25 (0.71)
	25	40 (1.13)	37 (1.05)	34 (0.96)	31 (0.88)
	35	55 (1.56)	51 (1.44)	47 (1.33)	43 (1.22)
	50	78 (2.21)	73 (2.07)	67 (1.90)	61 (1.73)
	75	118 (3.34)	110 (3.12)	102 (2.89)	92 (2.61)
	100	157 (4.45)	146 (4.14)	136 (3.85)	123 (3.48)
	125	197 (5.58)	183 (5.18)	170 (4.82)	155 (4.39)

#### 50 HZ


Inlet Pressure psig (kgf/cm <sup>2</sup> )		175 (12.3)	150 (10.6)	125 (8.8)	100 (7.0)
Model	20	27 (0.76)	25 (0.71)	23 (0.65)	21 (0.59)
	25	33 (0.93)	31 (0.88)	29 (0.82)	26 (0.74)
	35	43 (1.22)	40 (1.13)	37 (1.05)	33 (0.93)
	50	78 (2.21)	73 (2.07)	67 (1.90)	61 (1.73)
	75	96 (2.72)	90 (2.55)	83 (2.35)	75 (2.12)
	100	131 (3.71)	122 (3.46)	113 (3.20)	102 (2.89)
	125	164 (4.65)	152 (4.31)	142 (4.02)	129 (3.65)

### 3.0 MAINTENANCE

**⚠ CAUTION** DRYER IS A PRESSURE CONTAINING DEVICE. DEPRESSURIZE BEFORE SERVICING.

#### 3.1 Ambient air filter - Clean accumulated dust and dirt from ambient air filter monthly or more often if air flow across the condenser is impeded.

- A. Remove top panel.
- B. Remove ambient air filter by sliding upwards.

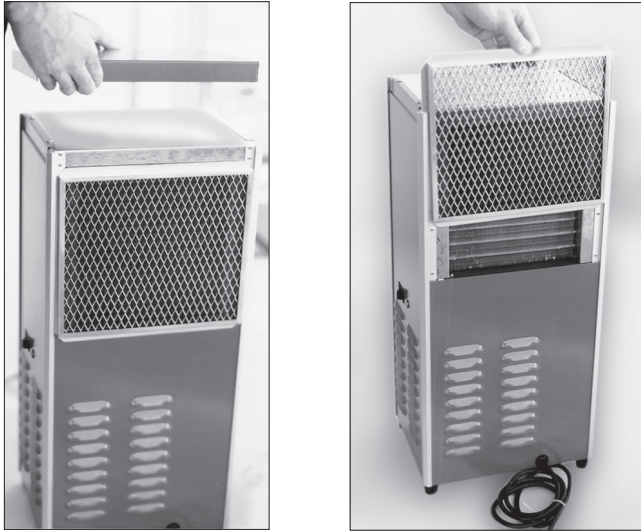


- C. Wash with soap and water and allow to dry before re-installing.

NOTE: Do not use solvents to clean ambient air filter.

- D. Reinstall filter and top panel.


#### 3.2 Inlet strainer - clean inlet strainer monthly or more often if rapid clogging occurs.

- A. Shut-off compressed air supply to the strainer and depressurize.
- B. Remove screen and clean or replace.
- C. Reinstall.

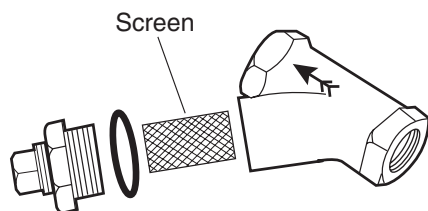

#### 3.3 Replace separator/filter element yearly or more often if pressure drop across the dryer is excessive.

- A. Shut-off compressed air supply to the dryer and depressurize.
- B. Remove top panel.
- C. Remove two screws holding side panel and remove side panel by sliding upwards.
- D. Disconnect drain tube from bulkhead fitting in cabinet base. To remove, press the plastic collar in, toward the fitting, while pulling the tube out of the fitting.
- E. Remove bowl - push bowl up, turn bowl 1/8th turn to your left, and pull straight down.
- F. Clean filter bowl.
- G. Replace element.

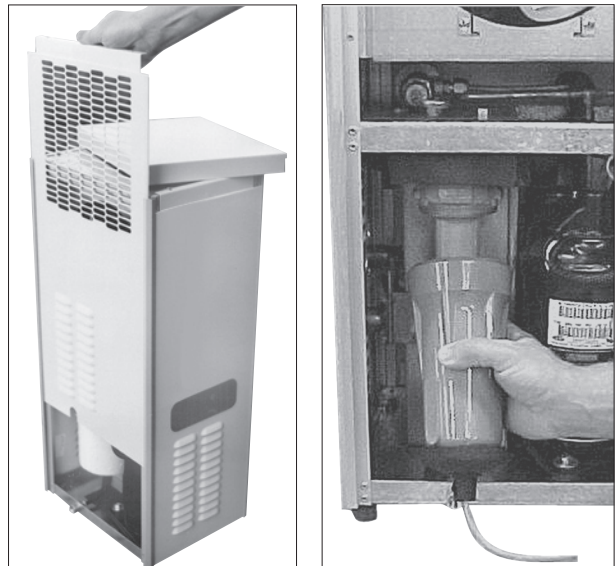


1. Replacing complete element
  - a) Pull off old element and discard.
  - b) Make certain O-ring inside top of replacement element is in place and push element onto filter head.
2. Replacing sleeve only
  - a) Pull element straight down to remove.
  - b) Remove bolt and bottom cap and remove disposable filter sleeve.
  - c) Clean separator core with soap and water if necessary
  - d) Slide new filter sleeve over separator core and replace bottom cap and hand tighten bolt.
  - e) Make certain O-ring inside top of element is in place and push element onto filter head.

- H. After making sure that O-ring and wave spring inside top of bowl are in place, reassemble bowl to head.

NOTE: Make certain O-ring is generously lubricated

NOTE: Wave spring ends should be pointed down to prevent the wave spring from interfering with reassembly.

- I. Reconnect drain tube to bulkhead fitting by pushing tube into fitting until it locks in position.
- J. Reinstall side and top panels.
- K. Repressurize dryer and resume operation.

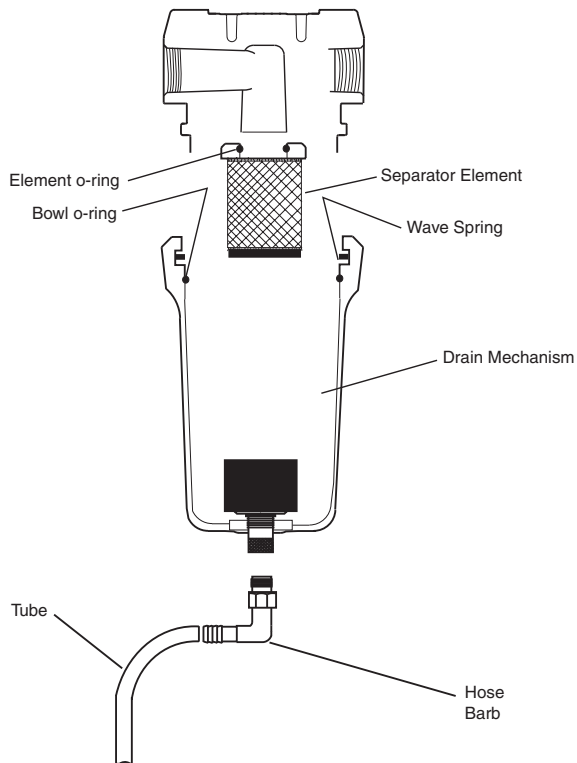

### 3.4 Automatic condensate drain

- Check daily to be sure automatic drain is discharging.
  - Replace drain mechanism yearly.
- A. Shut-off compressed air supply to the dryer and depressurize.
- B. Remove top panel.
- C. Remove two screws holding side panel then remove side panel by sliding upwards.
- D. Disconnect drain tube from bulkhead fitting in cabinet base. To remove, press the plastic collar in, toward the fitting, while pulling the tube out of the fitting.
- E. Remove bowl - push bowl up, turn 1/8th turn to your left, and pull bowl straight down.
- F. Remove drain tube fitting from bottom of bowl.
- G. Remove old drain mechanism by turning knurled fitting to the right (clockwise) and remove.
- H. Install new drain mechanism. If necessary, use a wire or pencil to guide the new mechanism into place.
- I. Reassemble drain tube fitting to bowl.
- J. After making sure that large O-ring in filter head is in place, reassemble bowl to head.
- K. Reconnect drain tube to bulkhead fitting by pushing tube into fitting until it locks in position.
- L. Reinstall top and side panels.
- M. Repressurize dryer and resume operation.

## TROUBLESHOOTING GUIDE

SYMPTOM	POSSIBLE CAUSE(S)	CORRECTIVE ACTION
<b>A) Water downstream of dryer</b>	<ol style="list-style-type: none"> <li>1. Residual free moisture remaining in downstream pipelines</li> <li>2. Air by-pass system is open</li> <li>3. Inlet and Outlet connections are reversed</li> <li>4. Temperatures surrounding air lines downstream of dryer have dropped below dryers dew point rating.</li> <li>5. Excessive free moisture (bulk liquid) at dryer inlet</li> <li>6. Condensate not being automatically drained Drain mechanism is clogged or inoperative. Drain line is restricted or frozen.</li> <li>7. Dryer overloaded resulting in elevated dew point.</li> <li>8. Refrigeration system not functioning properly resulting in elevated dew point.</li> </ol>	<p>Blow out system with dry air</p> <p>Check valve positions Check for correct connection</p> <p>Insulate or heat trace air lines exposed to low ambients or dry air to lower dew point</p> <p>Install separator ahead of dryer</p> <p>Replace drain mechanism if inoperative Open drain line Check inlet air temperature and pressure, flow rate (compressor capacity) and ambient air temperature See D below</p>
<b>B) High pressure drop across dryer</b>	<ol style="list-style-type: none"> <li>1. Inlet air strainer clogged</li> <li>2. Excessive air flow</li> <li>3. Separator filter clogged.</li> <li>4. Freezing of moisture in evaporator because of refrigeration system improperly functioning.</li> </ol>	<p>Clean inlet air strainer Check flow rate Replace filter sleeve See D below</p>
<b>C) Fault Alarm</b>	<ol style="list-style-type: none"> <li>1. Dryer overloaded resulting in high air outlet temperature.</li> <li>2. Refrigeration system not functioning properly resulting in high air outlet temperature.</li> <li>3. Unit functioning normally but thermostatic switch is malfunctioning or not securely mounted.</li> </ol>	<p>See A 7</p> <p>See D below</p> <p>Contact qualified refrigeration repairman or manufacturer's service department</p>
<b>D) Refrigeration system not functioning properly</b>	<ol style="list-style-type: none"> <li>1. When dryer on/off switch in on or "I" position <ol style="list-style-type: none"> <li>a. Power failure</li> <li>b. Line disconnect switch open</li> <li>c. Blown fuses, open breaker</li> <li>d. Faulty wiring, loose terminals</li> </ol> </li> <li>2. Refrigerant compressor cycles on and off <ol style="list-style-type: none"> <li>a. High or low ambient conditions</li> <li>b. Ambient air filter clogged</li> <li>c. Condenser fins clogged</li> <li>d. Fan motor or fan control switch malfunction</li> <li>e. Refrigerant leak</li> <li>f. Low voltage</li> </ol> </li> </ol>	<p>Check power to unit Close disconnect switch Check for continuity Have electrician check electrical connections</p> <p>Check minimum/maximum temperature ranges Clean ambient air filter Clean condenser Replace fan motor or fan control switch Contact qualified refrigeration repairman or manufacturer's service department Check wiring</p>



## SPECIFICATIONS - Models 20 thru 75

Description			Model				
			20	25	35	50	75
Operating Conditions							
Rated Capacity	scfm	60 / 50 Hz	20 / 17	25 / 21	35 / 27	50 / 50	75 / 61
@125 psig, 8.8 kgf/cm²*	m³/min	60 / 50 Hz	0.57 / 0.48	0.71 / 0.59	0.99 / 0.76	1.42 / 1.42	2.12 / 1.7
Maximum Working Pressure			250 psig (17.6 kgf/cm²)				
Maximum Inlet Temperature			180°F (82°C)				
Min/Max. Ambient Temperature			35-110°F (2-43°C)				
Pressure Drop @	psi	60 / 50 Hz	4.5 / 2.9	3.3 / 2.4	4.7 / 2.9	4.5 / 4.5	3.8 / 2.2
rated capacity	(kgf/cm²)	60 / 50 Hz	(0.32 / 0.20)	(0.23 / 0.17)	(0.33 / 0.20)	(0.32 / 0.32)	(0.27 / 0.15)
Refrigeration System Data							
Compressor Type			Hermetic, Rotary, Permanent Split Capacitor				
BTU/HR - Refrigeration Only			8720 / 7043			12500 / 9970	
@ ASRE-T Conditions 60 / 50 Hz							
Outlet Air Temperature (nominal @ rated conditions)			155°F (68°C)				
Refrigerant Type			R-407C				
Refrigerant Charge	oz (grams)	60 / 50 Hz	See Dryer Serial Tag				
Suction Pressure Setting			67 psig (4.7 kgf/cm²)				
Factory Test (design) Pressure high side/low side			330/178 psig (23.2/12.5 kgf/cm²)				
Condenser Fan Switch Setting (in-out)			240-180 psig (16.9-12.7 kgf/cm²)				
Air Flow Across Condenser	cfm	60 / 50 Hz	280 / 235			620 /515	
	m³/min	60 / 50 Hz	(7.9 / 6.7)			(17.6 / 14.6)	
Electrical Data							
Unit	115/1/60		115/1/60				
VAC/phase/Hz							
Minimum/maximum volts			98-127				
Full Load Amps (FLA)			8.7			12.6	
Branch Circuit Fuse Size (amps)			15			20	
Compressor			115/1/60				
Volts/phase/Hz							
Rated Load amps (RLA)			7.5			11.0	
Locked Rotor amps (LRA)			44.0			67.0	
Watts (input)			853			1220	
Overload			Thermal and Current (Auto Reset)				
Condenser fan motor			115/1/25			115/1/35	
Volts/phase/Watts (output)							
Full Load Amps (FLA)			1.2			1.6	
Other Loads			115/0.002/0.2				
Volts/amps/Watts							
Unit	220-240/1/50		220-240/1/50				
VAC/phase/Hz							
Minimum/maximum volts			198-264				
Full Load Amps (FLA)			3.4			6.0	
Branch Circuit Fuse Size (amps)			15				
Compressor			220-240/1/50				
Volts/phase/Hz							
Rated Load amps (RLA)			2.8			5.1	
Locked Rotor amps (LRA)			18.6			28.0	
Watts (input)			690			990	
Overload			Thermal and Current (Auto Reset)				
Condenser fan motor			220-240/1/18.3			220-240/1/25.6	
Volts/phase/Watts (output)							
Full Load Amps (FLA)			0.6			0.8	
Other Loads			220-240/0.002/0.4				
Volts/amps/Watts							

\* Capacity @ 180°F, 82°C inlet temperature, 160°F, 71°C inlet pressure dew point, 95°F, 35°C ambient temperature, 50°F, 10°C outlet pressure dew point, and less than 5 psi, 0.35 kgf/cm<sup>2</sup> pressure drop.

## SPECIFICATIONS - Models 100 and 125


Description			Model	
			100	125
<b>Operating Conditions</b>				
Rated Capacity	scfm	60 / 50 Hz	100 / 83	125 / 104
@125 psig, 8.8 kgf/cm <sup>2</sup> *	m <sup>3</sup> /min	60 / 50 Hz	2.83 / 2.35	3.54 / 2.95
Maximum Working Pressure			250 psig (17.6 kgf/cm <sup>2</sup> )	
Maximum Inlet Temperature			180°F (82°C)	
Min/Max. Ambient Temperature			35-110°F (2-43°C)	
Pressure Drop @	psi	60 / 50 Hz	3.5 / 2.6	4.6 / 3.1
rated capacity	(kgf/cm <sup>2</sup> )	60 / 50 Hz	(0.25 / 0.18)	(0.32 / 0.22)
<b>Refrigeration System Data</b>				
Compressor Type			Hermetic, Rotary, Permanent Split Capacitor	
BTU/HR - Refrigeration Only @ ASRE-T Conditions			24880 / 19543	
60 / 50 Hz				
Outlet Air Temperature (nominal @ rated conditions)			155°F (68°C)	
Refrigerant Type			R-22	
Refrigerant Charge			See Dryer Serial Tag	
Suction Pressure Setting			67 psig (4.7 kgf/cm <sup>2</sup> )	
Factory Test (design) Pressure high side/low side			278/144 psig (19.6/10.1 kgf/cm <sup>2</sup> )	
Condenser Fan Switch Setting (in-out)			240-180 psig (16.9-12.7 kgf/cm <sup>2</sup> )	
Air Flow Across Condenser			830 / 690	
	cfm	60 / 50 Hz	(23.5 / 19.5)	
	m <sup>3</sup> /min	60 / 50 Hz		
<b>Electrical Data</b>				
Unit			208-230/1/60	
VAC/phase/Hz			230/1/60	
Minimum/maximum volts			187-253	
Full Load Amps (FLA)			11.7	
Branch Circuit Fuse Size (amps)			20	
Compressor				
Volts/phase/Hz			208-230/1/60	
Rated Load amps (RLA)			10.6	
Locked Rotor amps (LRA)			58.0	
Watts (input)			2415	
Overload			Thermal and Current (Auto Reset)	
Condenser fan motor				
Volts/phase/Watts (output)			230/1/60	
Full Load Amps (FLA)			1.1	
Other Loads				
Volts/amps/Watts			230/0.002/0.4	
Unit			220-240/1/50	
VAC/phase/Hz			220-240/1/50	
Minimum/maximum volts			198-264	
Full Load Amps (FLA)			10.5	
Branch Circuit Fuse Size (amps)			15	
Compressor				
Volts/phase/Hz			220-240/1/50	
Rated Load amps (RLA)			9.4	
Locked Rotor amps (LRA)			38.7	
Watts (input)			2050	
Overload			Thermal and Current (Auto Reset)	
Condenser fan motor				
Volts/phase/Watts (output)			230/1/50	
Full Load Amps (FLA)			1.1	
Other Loads				
Volts/amps/Watts			220-240/0.002/0.4	

\* Capacity @ 180°F, 82°C inlet temperature, 160°F, 71°C inlet pressure dew point, 95°F, 35°C ambient temperature, 50°F, 10°C outlet pressure dew point, and less than 5 psi, 0.35 kgf/cm<sup>2</sup> pressure drop.




## ELECTRICAL SCHEMATICS


Models 20 thru 75 - All Voltages  
Only Models 50 and 75 - 230-1-50/60

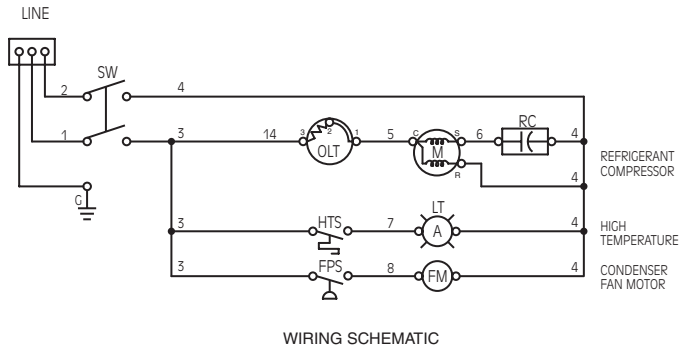

Models 100 and 125 - All Voltages

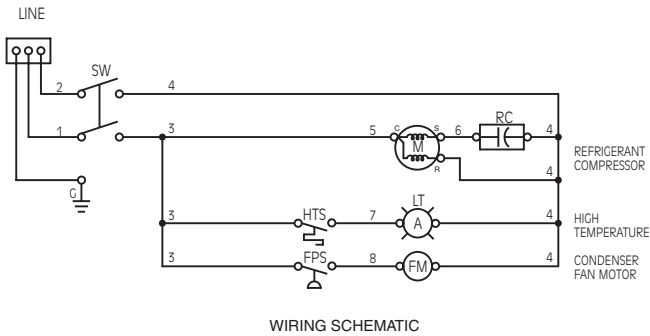


Only Models 50 and 75 - 115-1-50/60

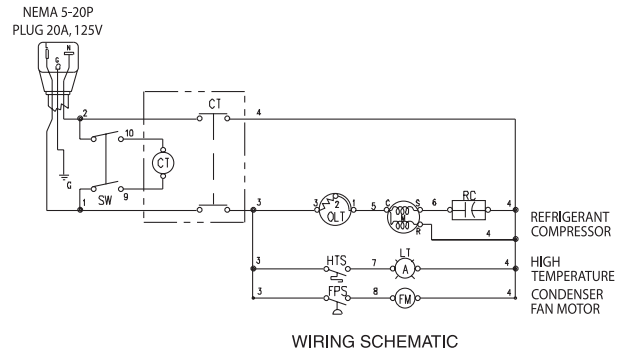

### LEGEND


- SW - On/Off Switch
- OLT - Thermal Overload
- M - Compressor Motor
- RC - Run Capacitor
- HTS - High Temperature Switch
- LT - Fault Light
- FPS - Fan Pressure Switch
- FM - Fan Motor
- TB - Terminal Block
- CT - Contactor w/115V Coil

Models 20 thru 125 - All Voltages

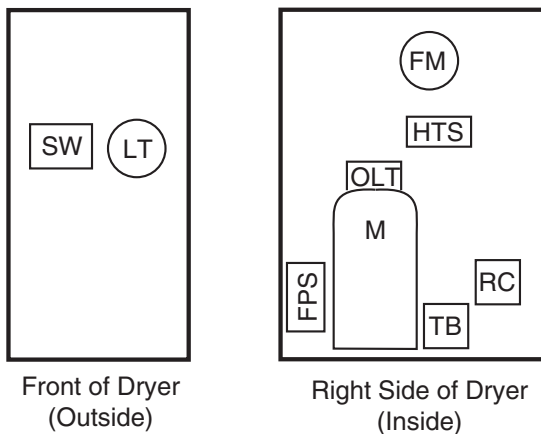

COMPONENT LOCATIONS

Only Models 50 and 75 - 115-1-50/60


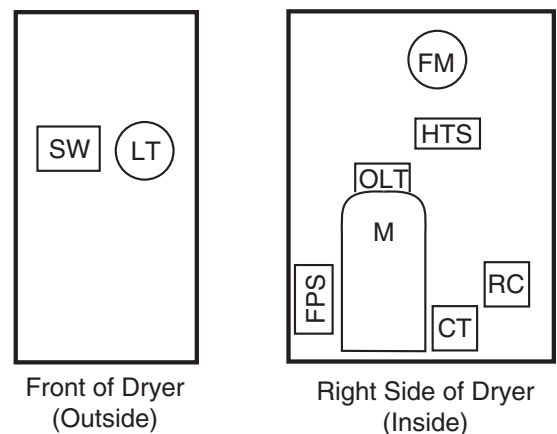


COMPONENT LOCATIONS

DIMENSIONS AND WEIGHTS

Models 20, 25, 35



Model	Weight
20	79 lbs (36 kg)
25	80 lbs (36 kg)
35	81 lbs (37 kg)

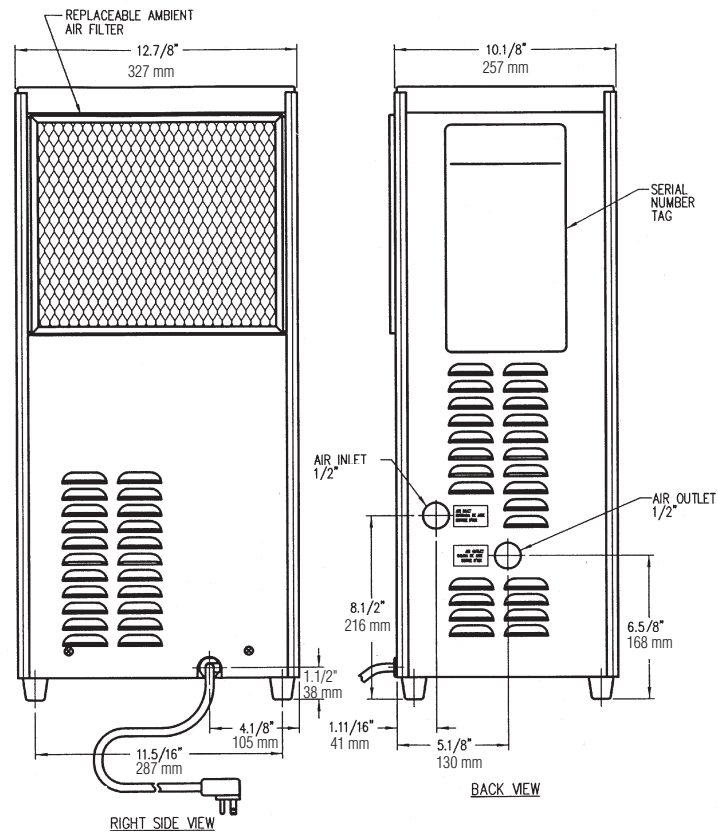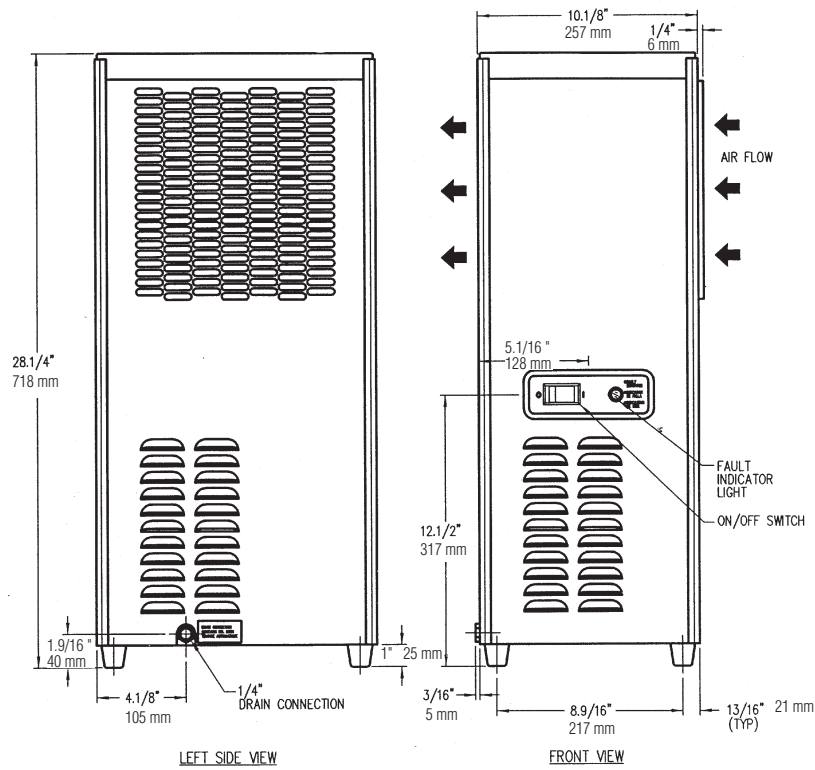

**DIMENSIONS AND WEIGHTS**

**Models 50 and 75**



Model	Weight
50	150 lbs (68 kg)
75	155 lbs (70 kg)

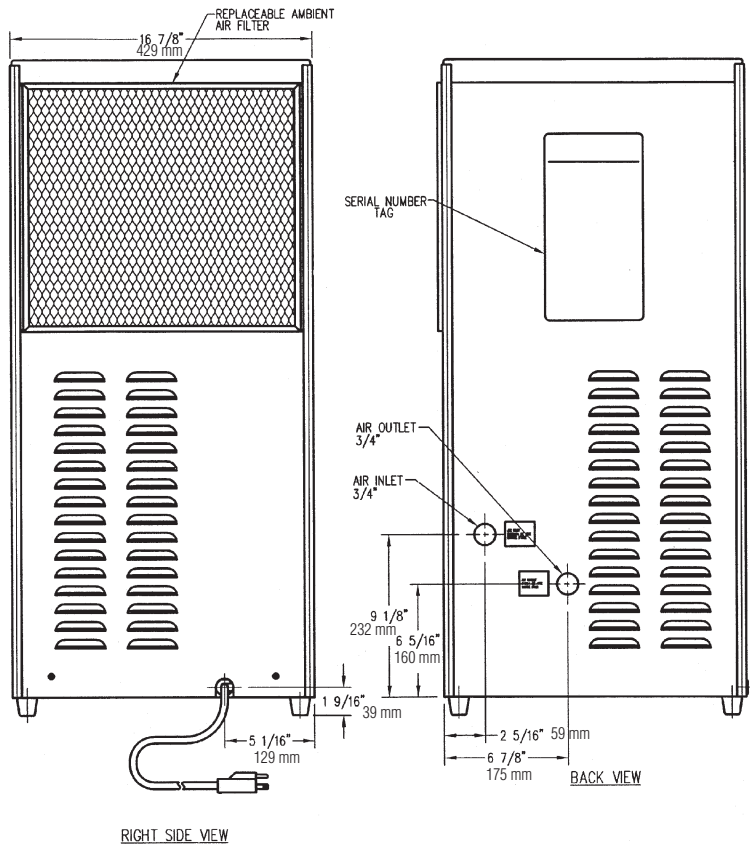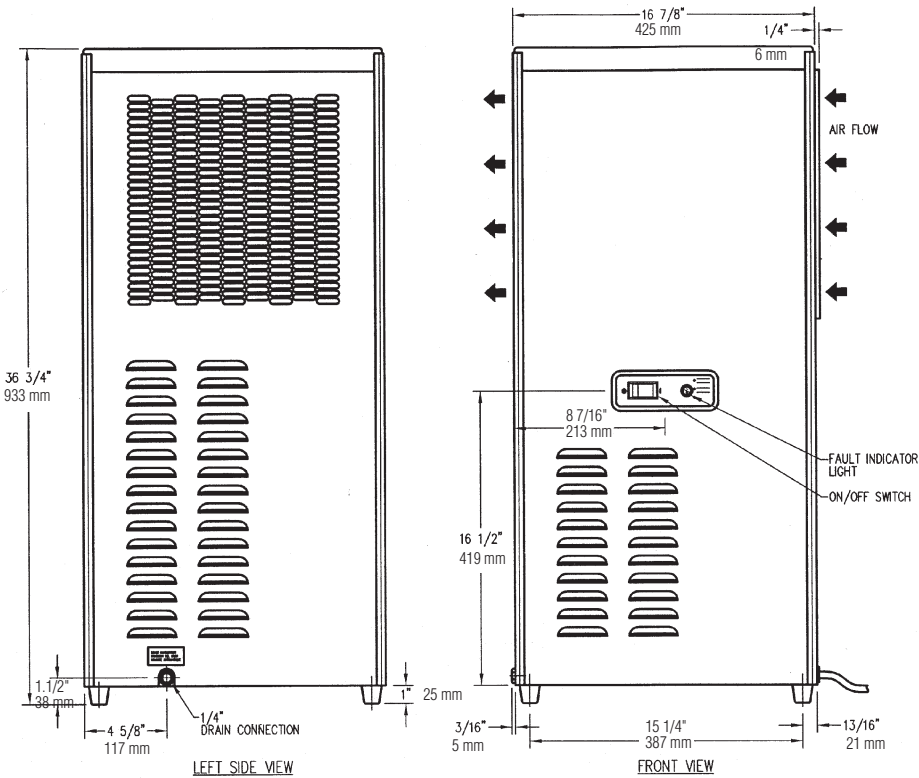

DIMENSIONS AND WEIGHTS

Models 100 and 125

Model	Weight
100	187 lbs (85 kg)
125	189 lbs (86 kg)

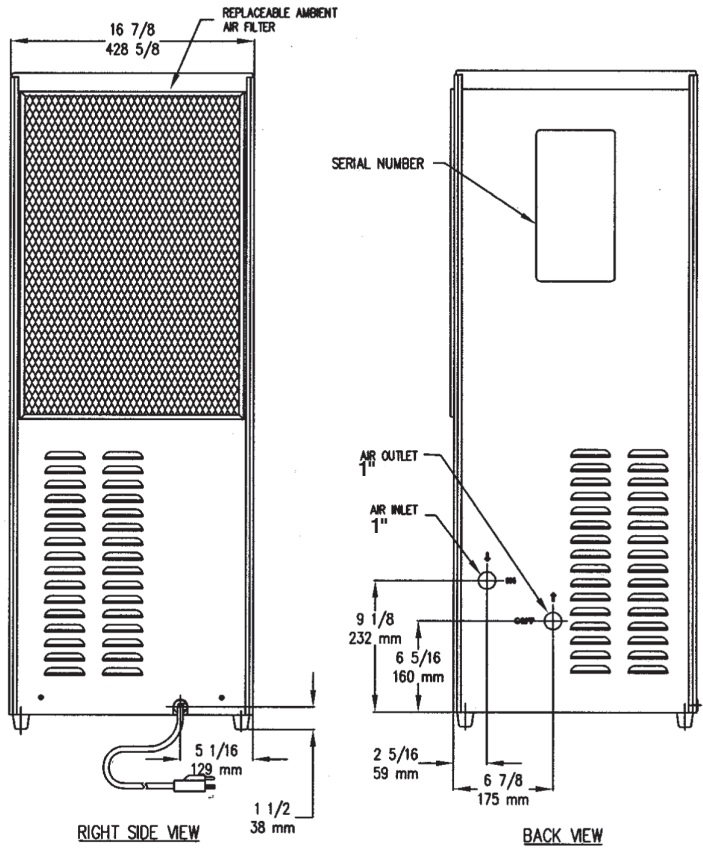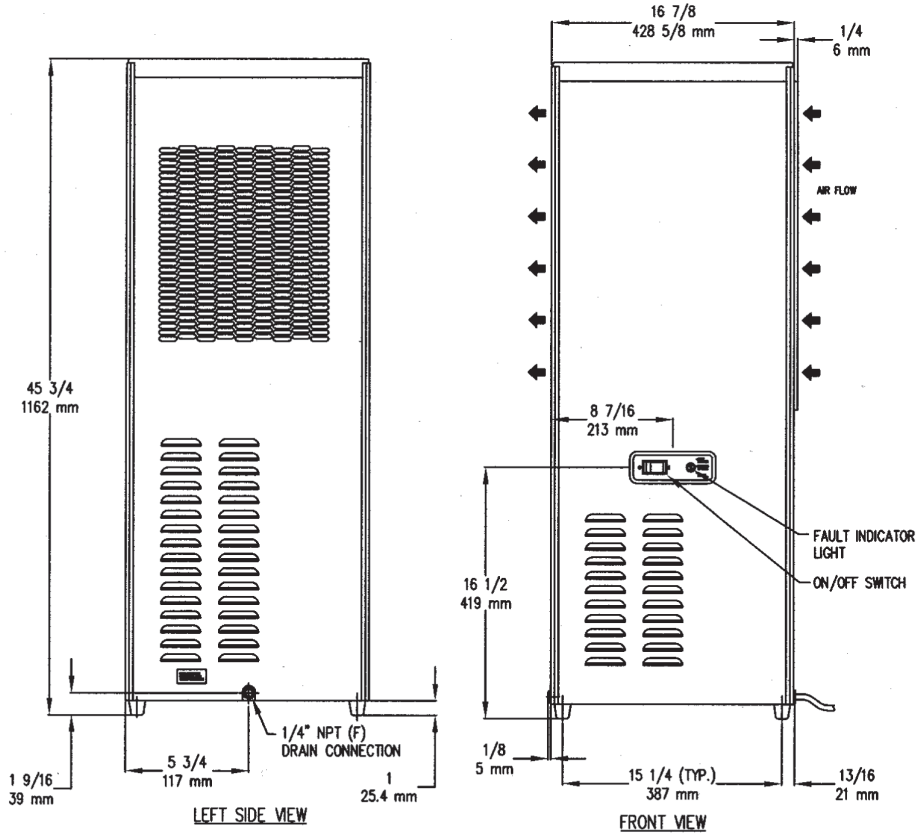

## PARTS LIST

PARTS DESCRIPTION	20	25	35	50	75
<b>Separator</b>					
*Separator/Filter Cartridge	E9-16	E9-16	E9-16	E9-20	E9-24
Filter Sleeve	S9-16	S9-16	S9-16	S9-20	S9-24
*Drain Mechanism	3152270	3152270	3152270	3152270	3152270
Bowl	3240333	3240333	3240333	3223457	3241108
*O-ring Bowl	3154585	3154585	3154585	3162913	3162913
<b>Inlet (Compressed Air) Strainer</b>					
Strainer, inlet	4009634	4009634	4009634	4009635	4009635
*Screen, strainer	3230672	3230672	3230672	3230673	3230673
<b>Electrical</b>					
Switch on/off	3230775	3230775	3230775	3230775	3230775
Light, Fault (amber) <b>115/1/60</b>	3227423	3227423	3227423	3227423	3227423
Light, Fault (amber) <b>220-240/1/50</b>	3227424	3227424	3227424	3227424	3227424
Cord Set <b>115/1/60</b>	3221571	3221571	3221571	3221572	3221572
Cord Set <b>230/1/60</b>	3234513	3234513	3234513	3234514	3234514
Cord Set <b>220-240/1/50</b>	3221422	3221422	3221422	3221422	3221422
Capacitor, run <b>115/1/60</b>	3220878	3220878	3220878	3220878	3220878
Capacitor, run <b>220-240/1/50</b>	3220872	3220872	3220872	3220878	3220878
Capacitor, run <b>208-230/1/60</b>	3220878	3220878	3220878	3220878	3220878
Switch, fault light w/conn.	3240331	3240331	3240331	3240597	3240597
<b>Condenser Fan</b>					
Fan Motor <b>115/1/60</b>	3228001	3228001	3228001	3227992	3227992
Fan Motor <b>220-240/1/50</b>	3228002	3228002	3228002	3227986	3227986
Fan Motor <b>208-230/1/60</b>	3236665	3236665	3236665	3227986	3227986
Fan Blade <b>115/1/60</b>	3219394	3219394	3219394	3219395	3219395
Fan Blade <b>208-240-1-50/60</b>	3219394	3219394	3219394	3219399	3219399
<b>Refrigeration System</b>					
Compressor <b>115/1/60</b>	3221265	3221265	3221265	3221267	3221267
Compressor <b>208-230/1/60</b>	3234930	3234930	3234930	3234931	3234931
Compressor <b>220-240/1/50</b>	3221266	3221266	3221266	3221268	3221268
Condenser	3221323	3221323	3221323	3221324	3221324
Hot gas by-pass valve	3232549	3232549	3232549	3232526	3232526
Filter/Dryer	3223809	3223809	3223809	3223809	3223809
Fan Pressure Switch	3230755	3230755	3230755	3230756	3230756
<b>Cabinet</b>					
*Filter, Ambient Air	3223805	3223805	3223805	3223806	3223806
Grommet (light & switch, front panel)	3224016	3224016	3224016	3224016	3224016
Foot, mounting	3223838	3223838	3223838	3223838	3223838

\* Maintenance kits for the above models are available "\*" indicates items included in the kits.

## Maintenance Kits

For Dryer Models	Kit Number
20, 25, 35	HITFMK1
50	HITFMK2
75	HITFMK3

## PARTS LIST

PARTS DESCRIPTION	100	125
<b>Separator</b>		
*Separator/Filter Cartridge	E9-24	E9-24
Filter Sleeve	S9-24	S9-24
*Drain Mechanism	3152270	3152270
Bowl	3241108	3241108
*O-ring Bowl	3162913	3162913
Strainer, inlet	4009636	4009636
*Screen, strainer	3230662	3230662
<b>Electrical</b>		
Switch on/off	3230775	3230775
Light, Fault 230v	3227424	3227424
Cord Set	3221573	3221573
Capacitor, run <b>230/1/60</b>	3065778	3065778
Capacitor, run <b>220-240/1/50</b>	3065778	3065778
Switch, fault light w/conn.	3240597	3240597
<b>Condenser Fan</b>		
Fan Motor	3227986	3227986
Fan Blade	3219404	3219404
<b>Refrigeration System</b>		
Compressor <b>230/1/60</b>	3221269	3221269
Compressor <b>220-240/1/50</b>	3248475	3221270
Condenser	3221325	3221325
Hot gas by-pass valve	3232526	3232526
Filter/Dryer	3223814	3223814
Fan Pressure Switch	3230756	3230756
<b>Cabinet</b>		
*Filter, Ambient Air	3223807	3223807
Grommet (light & switch, front panel)	3224016	3224016
Foot, mounting	3223838	3223838

\* Maintenance kits for the above models are available "\*" indicates items included in the kits.

## Maintenance Kits

For Dryer Models	Kit Number
100	HITFMK4
125	HITFMK4



## NOTES

# WARRANTY

The manufacturer warrants the product manufactured by it, when properly installed, operated, applied, and maintained in accordance with procedures and recommendations outlined in manufacturer's instruction manuals, to be free from defects in material or workmanship for a period as specified below, provided such defect is discovered and brought to the manufacturer's attention within the aforesaid warranty period.

The manufacturer will repair or replace any product or part determined to be defective by the manufacturer within the warranty period, provided such defect occurred in normal service and not as a result of misuse, abuse, neglect or accident. Normal maintenance items requiring routine replacement are not warranted. The warranty covers parts and labor for the warranty period unless otherwise specified. Repair or replacement shall be made at the factory or the installation site, at the sole option of the manufacturer. Any service performed on the product by anyone other than the manufacturer must first be authorized by the manufacturer.

Unauthorized service voids the warranty and any resulting charge or subsequent claim will not be paid. Products repaired or replaced under warranty shall be warranted for the unexpired portion of the warranty applying to the original product.

The foregoing is the exclusive remedy of any buyer of the manufacturer's product. The maximum damages liability of the manufacturer is the original purchase price of the product or part.

THE FOREGOING WARRANTY IS EXCLUSIVE AND IN LIEU OF ALL OTHER WARRANTIES, WHETHER WRITTEN, ORAL, OR STATUTORY, AND IS EXPRESSLY IN LIEU OF THE IMPLIED WARRANTY OF MERCHANTABILITY AND THE IMPLIED WARRANTY OF FITNESS FOR A PARTICULAR PURPOSE. THE MANUFACTURER SHALL NOT BE LIABLE FOR LOSS OR DAMAGE BY REASON OF STRICT LIABILITY IN TORT OR ITS NEGLIGENCE IN WHATEVER MANNER INCLUDING DESIGN, MANUFACTURE OR INSPECTION OF THE EQUIPMENT OR ITS FAILURE TO DISCOVER, REPORT, REPAIR, OR MODIFY LATENT DEFECTS INHERENT THEREIN.

THE MANUFACTURER, HIS REPRESENTATIVE OR DISTRIBUTOR SHALL NOT BE LIABLE FOR LOSS OF USE OF THE PRODUCT OR OTHER INCIDENTAL OR CONSEQUENTIAL COSTS, EXPENSES, OR DAMAGES INCURRED BY THE BUYER, WHETHER ARISING FROM BREACH OF WARRANTY, NEGLIGENCE OR STRICT LIABILITY IN TORT.

The manufacturer does not warrant any product, part, material, component, or accessory manufactured by others and sold or supplied in connection with the sale of manufacturer's products.

## Warranty Period

Parts and labor for two (2) years from the date of shipment from the factory; heat exchangers are covered (parts only) for an additional three (3) years (total of five (5)). On units that manufacturer requests be returned to the factory, a one time removal/reinstallation labor allowance as noted in the Service Warranty Policies and Procedures Handbook will apply. Freight to the factory from the installation site and to the installation site from the factory will be paid by the manufacturer; means of transportation to be specified by manufacturer.

**AUTHORIZATION FROM THE SERVICE DEPARTMENT IS NECESSARY BEFORE MATERIAL IS RETURNED TO THE FACTORY OR IN-WARRANTY REPAIRS ARE MADE.**

**SERVICE DEPARTMENT: (724) 746-1100**



HANKISON, AN SPX BRAND  
1000 PHILADELPHIA STREET  
CANONSBURG, PA 15317-1700 U.S.A.  
TEL | 724 | 745 | 1555 FAX | 724 | 745 | 6040  
Email: [hankison.service@spx.com](mailto:hankison.service@spx.com)  
[www.hankisonintl.com](http://www.hankisonintl.com)



**SPX**  
DEHYDRATION & FILTRATION

© 2009 SPX Corporation. All rights reserved.

Improvements and research are continuous at Hankison. Specifications may change without notice.